



AP275-705N4 Combination Strobe Light and Alarm Horn for Safety Stations, with Remote Sensing Flow Switch Assembly, NEMA 4 Rated Components

Application: Combination strobe light and alarm horn unit for safety stations. Strobe light activates and alarm horn sounds loudly when eyewash or shower is activated. NEMA 4 components provide a watertight seal. Unit is ideal for use in wash-down applications, as well outdoor use where protection against moisture and rain is required. Furnished with additional contacts for connection to remote monitoring system.

Installation: Unit is designed for use with combination safety stations, and can be mounted on either the vertical pipe of the station or on a wall adjacent to the unit. 120 volt, 0.3 amp electrical supply is required.

Visual Signal: Amber strobe light with shatter-resistant lens. Peak candlepower of 2,000,000 and flash rate of 60 FPM.

Audible Signal: Horn delivers distinctive, urgent signal. Volume is preset at 100 db at 10 feet. An adjustment screw on the front of horn allows adjustment of output sound level.

Flow Switch: 1-1/4" IPS double pole, double throw waterproof flow switch for installation in water supply line to emergency unit. Switch senses flow of water when either the eyewash or shower is activated. Additional contacts send electrical signal to remote monitoring location. Flow switch must be installed with tee fitting in horizontal position, flow switch body in vertical position and at least 6" from closest fitting. Direction of flow is marked on switch body.

Mounting: Furnished complete with bracket for mounting on vertical pipe or wall, junction box and 5 foot flexible cord and receptacle. Electrical connection by others.

Quality Assurance: Unit is fully assembled, wired and factory tested prior to shipment.

Available Option

SW Silencing switch for alarm horn.


Additional Model

AP275-700N4 Same as above except with single pole, double throw flow switch for activating local alarm only.





AP275-705N4 Combination Strobe Light and Alarm Horn for Safety Stations, with Remote Sensing Flow Switch Assembly, NEMA 4 Rated Components

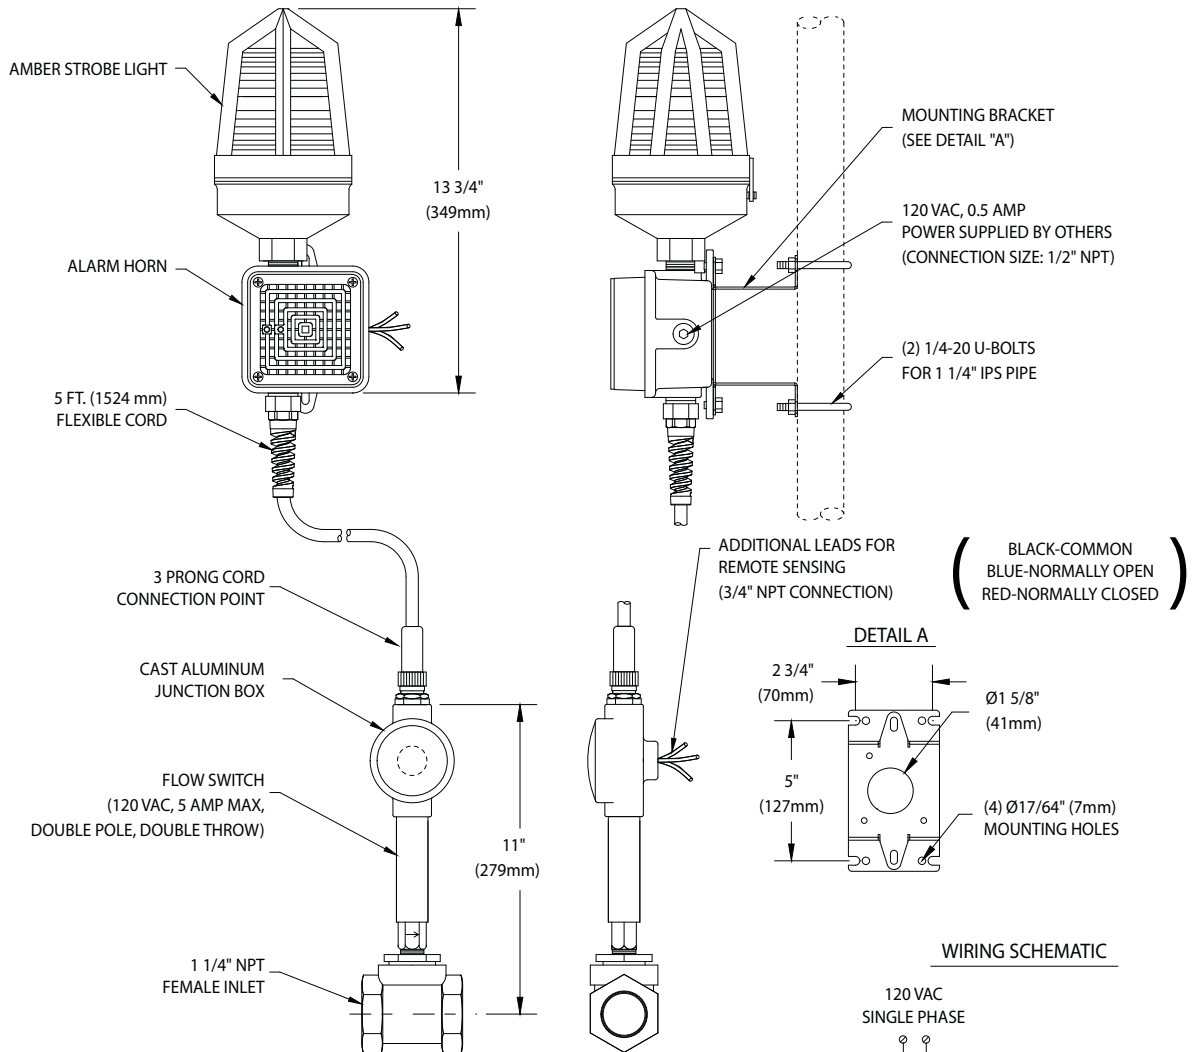

NOTES:

1. FLOW SWITCH IS DESIGNED TO ACTIVATE AT 0.75 GPM AND DEACTIVATE AT 0.60 GPM.
2. FLOW SWITCH MUST BE INSTALLED VERTICALLY IN A HORIZONTAL PIPE RUN, UPSTREAM OF UNIT AND AT LEAST 6" FROM FITTING.
3. SOUND OUTPUT ON HORN IS ADJUSTABLE FROM 0 TO 100 dB AT 10 FT.
4. COMPONENTS MEET NEMA 4 OR EXCEED REQUIREMENTS.

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are ± 1/4" (6mm). rev. 110118