


M-9562 4

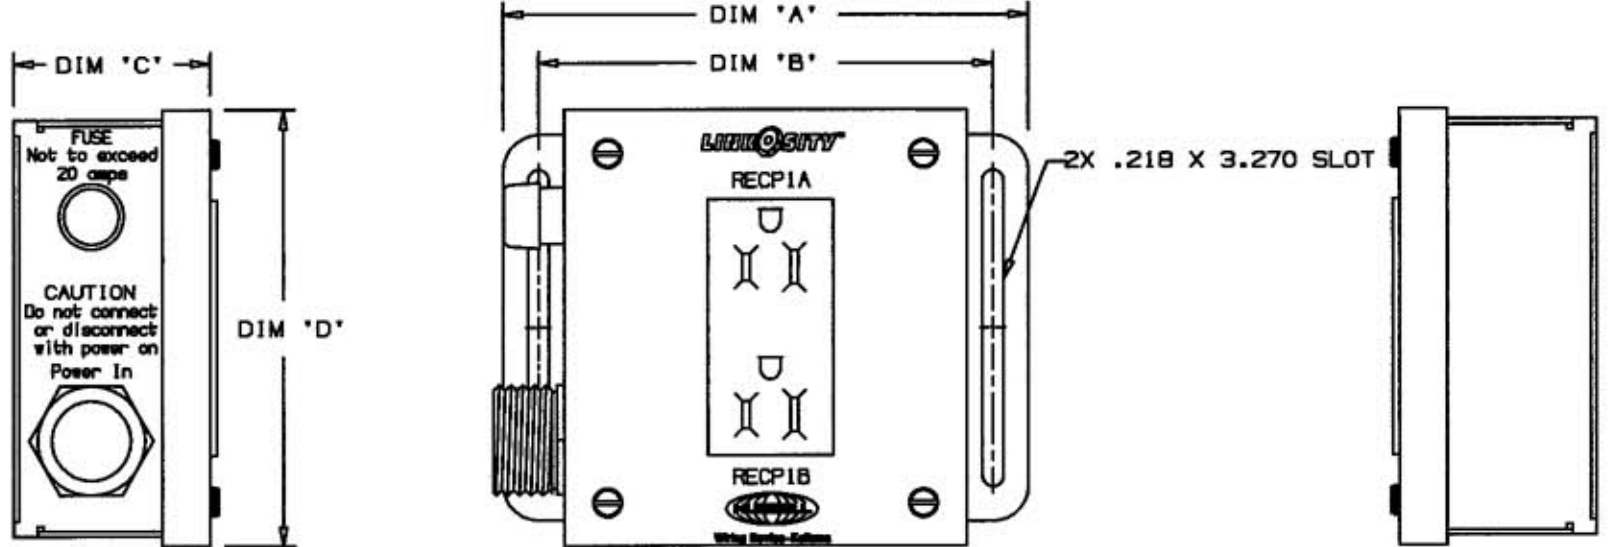

CATALOG NUMBER, M001****0 SHOWN

CAT. NUMBER 1	RECEPTACLES	DIMENSION 'A'	DIMENSION 'B'	DIMENSION 'C'	DIMENSION 'D'
M001****0	1	5.50 [139.7]	4.75 [120.7]	2.25 [57.2]	4.53 [115.1]
M002****0	2	7.50 [190.5]	6.75 [171.5]	2.25 [57.2]	4.53 [115.1]
M003****0	3	9.50 [241.3]	8.75 [222.3]	2.25 [57.2]	4.53 [115.1]
M004****0	4	11.50 [292.1]	10.75 [273.1]	2.25 [57.2]	4.53 [115.1]
M005****0	5	13.50 [342.9]	12.75 [323.9]	2.25 [57.2]	4.53 [115.1]

CATALOG NUMBER
M 00 * * * * 0
CONSTANT VALUE "M" 1
SWITCH TYPE 2
NUMBER OF RECEPTACLES 3
RECEPTACLE TYPE 4
RECEPTACLE FEATURE 4
NO PASS-THRU

2 Switch Type

SL = Local On/Off	HBL1221PL
SM = Master On/Off	HBL1221PL
OO = NO SWITCH	N/A

3 Receptacle Type

		CR	HG	SG	L1	L2
		Corrosion Resistant	Hospital Grade	Specification Grade	NEMA L5-15R Twist Lock	NEMA L5-20R Twist Lock
4 Receptacle Feature	OO Standard	HBL53CM62	HBL8300GY	CR5362GY	HBL4700	HBL2310
	IG Isolated Ground	N/A	IG8300GY	CR5362IGGY	IG4700A	IG2310
	GF Ground Fault	N/A	GF8300GYA	<u>6</u> GFR5352GYL or GF20GYL	N/A	N/A
	SI Surge Suppression Isolated Ground	N/A	IG8362GYSA	IG5352GYSA	N/A	N/A
	SS Surge Suppression	N/A	HBL8362GYSA	HBL5362GYSA	N/A	N/A

LIST OF PARTS		
DESCRIPTION	MATERIAL	FINISH

4	GFR5352GYL WAS "GFR5352GYA" ADD "OR GF20GYL" ADD NOTE 6. "DO NOT USE GFCI RECEPTACLES WITH LED'S & GFCI RECEPTACLES WITHOUT LED'S IN THE SAME PSDA." DCN 13546 GPK CH	CH	1/8/07
3	ADDED "CAUTION..." PAD PRINTING. REMOVED "PL1" FROM "POWER IN" PRINTING. "FUSE" PRINTING WAS "FUI". RELOCATED "FUSE..." PRINTING ABOVE THE FUSE. REMOVED "PL1" FROM SCHEMATICS. "FUSE" WAS "FUI" ON SCHEM. "WN4 SEE NOTE 4" WAS "WN4". CAT. NO. "GFR5352GYA" WAS "CR5352GYA"	WRV	10/28/05
2	TABLE OF RECEPTACLE TYPE, L1 WAS 15, L2 WAS 20. TABLE OF CATALOG NUMBER, NO PASS THRU WAS PASS THRU. TITLE, ADDED W/NO PASS THRU PER DCN 12328 SPN	JPP	4/28/05
1	RELEASED PER DCN 12049. MYA	RDK	10/19/04
SYM	REVISIONS	APP	DATE

THE DESIGN AND DIMENSIONS OF THE PRODUCT SHOWN ON THIS DRAWING ARE SUBJECT TO CHANGE WITHOUT NOTICE


TITLE
20A PSDA W/NO PASS THRU

TOLERANCES UNLESS OTHERWISE SPECIFIED

FRACTIONS ± 1/8"
DECIMALS ± .005"
ANGLES ± 2°

WIRING DEVICE-KELLEMS HUBBELL INCORPORATED BRIDGEPORT, CT

DR. BY MYA APP. BY RDK
TR. BY SCALE NONE
CHK'D BY RDK DATE 10/19/04

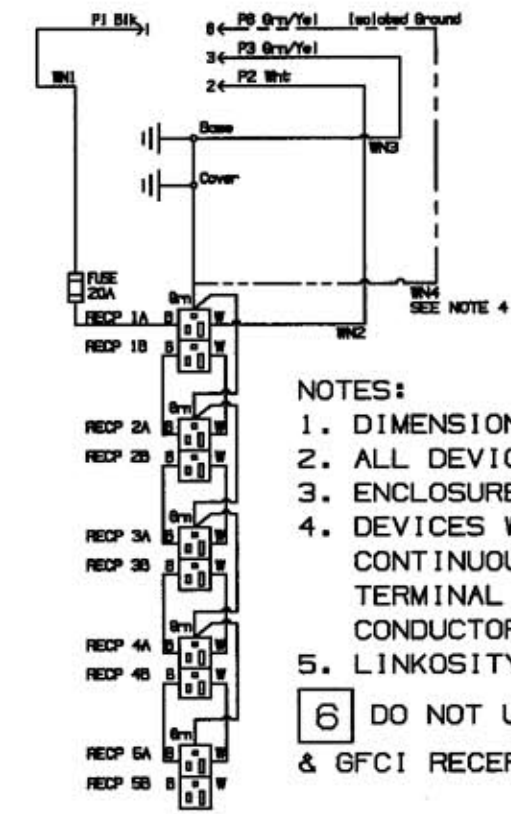

NOTES:

- DIMENSIONS ARE IN INCHES & [MM].
- ALL DEVICES ARE UL LISTED.
- ENCLOSURES RATING: TYPE 1.
- DEVICES WITH ISOLATED GROUND RECEPTACLES HAVE INSULATED CONTINUOUS CONDUCTOR TO RECEPTACLE ISOLATED GROUND TERMINAL ORIGINATING FROM WN4, OTHERWISE A CONTINUOUS CONDUCTOR TO GROUND TERMINALS ORIGNATE FROM WN3.
- LINKOSITY™ IS A TRADEMARK OF LOCKHEED MARTIN.
- 6 DO NOT USE GFCI RECEPTACLES WITH LED'S & GFCI RECEPTACLES WITHOUT LED'S IN THE SAME PSDA.

DIMENSION SHEET FOR CAT. NO.

REPAIRABLE

NON-REPAIRABLE

B

M-9562